






Villavent®

N Montasjeanvisning reguleringsbryter type CTK/B-S **GB** Installation instruction controller type CTK/B-S

N Villavent reguleringsbryter type CTK/B-S (hastighetsregulering i 3 trinn). Reguleringsbryteren bør plasseres på et lett synlig sted. Dette kan i boliger være f.eks. stue, kjøkken eller entrè/hall. Reguleringsbryteren leveres for både innfelt og utenpåliggende montasje, og er tilpasset ELKO montasjesystem.	GB Villavent control switch, type CTK/B-S (3-step speed controller) Install the controller in a visible place, i.e. on a wall in the livingroom, kitchen or hallway. The controller is supplied for either flush or surface mounted, adaptable in ELKO frame and wall boxes.
N Innfelt montasje (standard) GB Flush installation Separat reguleringsbryter 	N Utenpåliggende montasje GB Surface mounted (standard) Separate control switch 
N Installasjonsmateriell, innfelt montasje GB Installation material, flush installation  N 1 stk. veggbox, L458 GB 1 pc. wall box, L458	N Installasjonsmateriell, utenpåliggende montasje GB Installation material, surface mounted  N 2 stk. kapper, L675 GB 2 pc. frames, L675
N El.tilkoblinger NB! All elektrisk installasjon skal utføres av autorisert installatør iht. forskrifter for el.anlegg. Det må monteres opplegg for 10 A, 230 V, 1-fase, jordet stikkontakt ved aggregatet. Trafoboks monteres under aggregatet og forbindes deretter med 4 x 1,5 mm² PN ledning til reguleringsbryter. Legges vanligvis i 1x16 mm trekkerør.	GB Electrical connections NOTE! All electrical installations must be made by an authorized installer and in accordance with the regulations in force. Install a fused spur outlet (13 A, 240 V, single phase) adjacent to the unit. Mount the transformer box under the unit, and connect transformer box to the controller by means of 4 x 1,5 mm² cores, through 1x16 mm conduit.

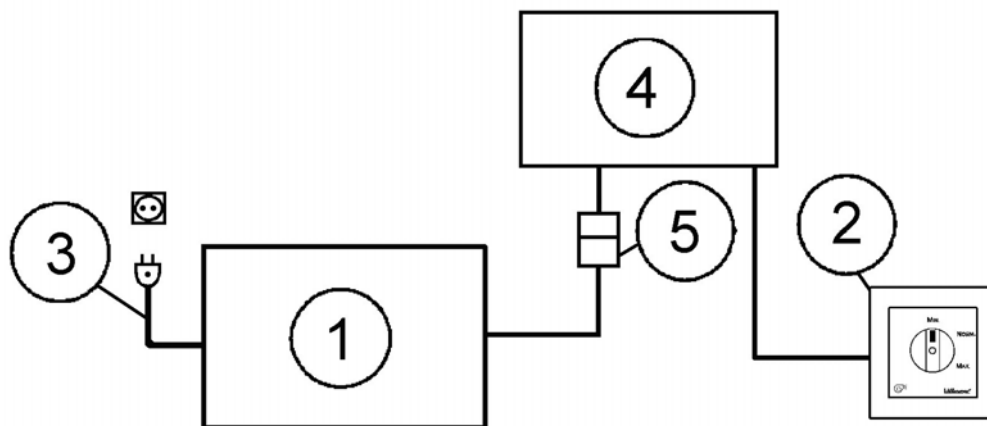

N Prinsipp el. tilkobling

- 1.) Vifte/aggregat
- 2.) Reguleringsbryter
- 3.) Ledning m/jordet støpsel
- 4.) Trafoboks
- 5.) Hurtigkobling

GB


- 1.) Unit
- 2.) Controller
- 3.) Cable with plug
- 4.) Transformer box
- 5.) Quick connector

N Koblingsskjema reguleringsbryter, type CTK/B-S

(mellom bryter på vegg og trafoboks under aggregat)

GB

Wiring diagram controller, type CTK/B-S
(between controller on the wall and transformer box under the unit).

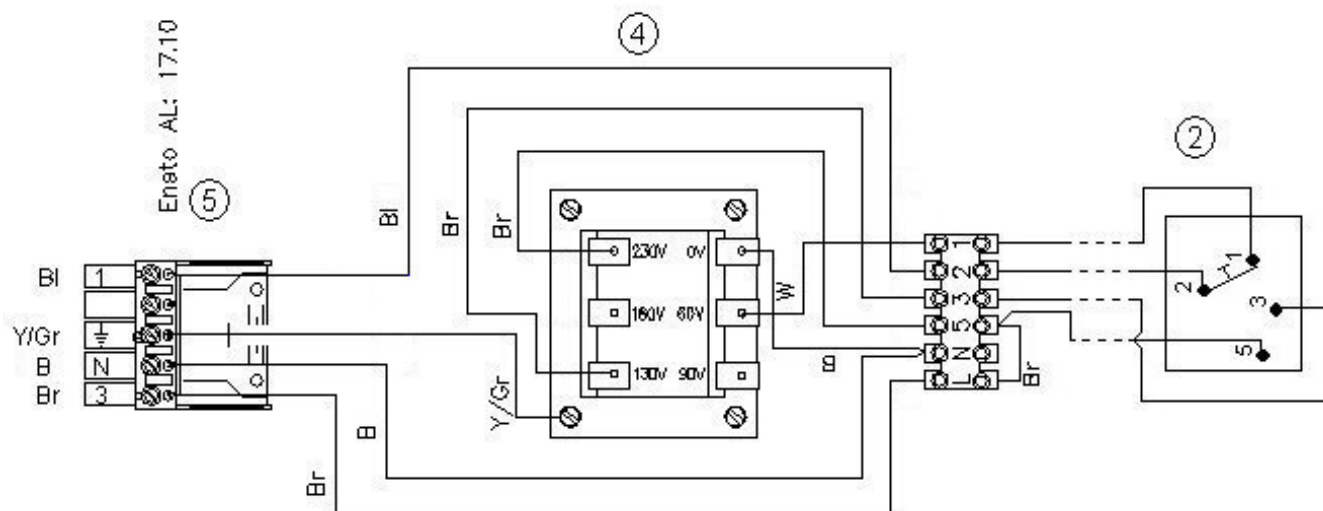

- N**
- | | | |
|------|---|-----------|
| Bl | = | Sort |
| Y/Gr | = | Gul/Grønn |
| B | = | Blå |
| Br | = | Brun |
| W | = | Hvit |

- GB**
- | | | |
|------|---|--------------|
| Bl | = | Black |
| Y/Gr | = | Yellow/Green |
| B | = | Blue |
| Br | = | Brown |
| W | = | White |

N Rett til endringer forbeholdes

GB Specifications may be changed without notice

Produsent/Hersteller/Manufacturer:

Forhandler/Distributor: